

ATI-5020-OWS Probe Configuration



FOR VARIABLE VOLUME OIL-WATER SEPARATORS.

A.T.Monitors Order ID #: _____
 Customer: _____
 Customer PO #: _____

Probe dimensions are in inches, cm.
NOTE: F2 (see diagram at right) is a special water-buoyant float.

Dimensions

- [A]- Out-of-tank Length = _____ (minimum 8" / 20.3cm)
- [B]- In-tank Length = _____ (must be less than tank depth)
- [C]- Height of manway, riser pipe, reducer fitting(s) or other non-detecting portion of [B] = _____ (if applicable).
- Total shaft length = **A + B** or **A + B + C**
- [D]- Minimum 2" / 5cm (remaining length to bottom of probe)
- [E]- Overflow volume level alarm trip point = _____
- [F]- High oil-water level trip point = _____
- [G]- Low oil-water level trip point = _____
- [H]- NPT reducer fitting = 2" (standard), 1-1/2" or other (please specify) _____.


The probe's NPT reducer fitting is to be screwed into
 Tank, Manway, Riser pipe, Reducer fitting(s).

Product in Tank

- Waste oil and Water mix,
- Other mix (please specify): _____.

Customer Approval

Print name: _____
 Signature: _____
 Date: _____
 (mm/dd/yyyy)

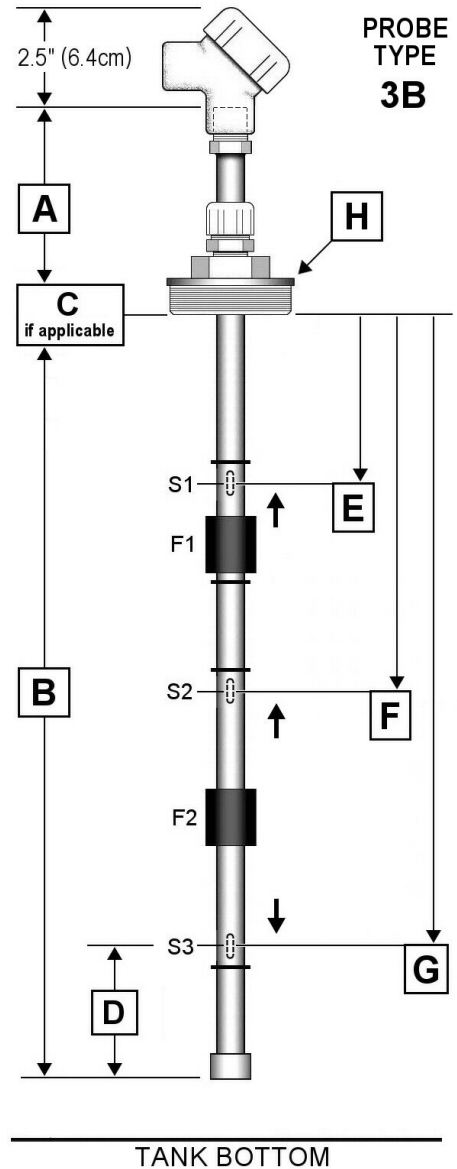

For office use only
<p>ATI-5020-OWS Probe Serial #: _____</p> <p>Monitor (optional) Model #: _____ Serial #: _____</p>