

ATI-5020-OWZ Probe Configuration



FOR CONSTANT VOLUME OIL-WATER SEPARATORS.

A.T.Monitors Order ID #: _____
 Customer: _____
 Customer PO #: _____

Probe dimensions are in inches, cm.

NOTE: F1 and F2 (see diagram) are special water-buoyant floats.

Dimensions

[A]- Out-of-tank Length = _____ (minimum 8" / 20.3cm)
 [B]- In-tank Length = _____ (must be less than tank depth)
 [C]- Height of manway, riser pipe, reducer fitting(s) or other non-detecting portion of [B] = _____ (if applicable).

Total shaft length = **A + B** or **A + B + C**

[D]- Minimum 2" / 5cm (remaining length to bottom of probe)

[E]- High oil-water level trip point = _____

[F]- Low oil-water level trip point = _____

[G]- NPT reducer fitting = 2" (standard), 1-1/2" or other (please specify) _____.

The probe's NPT reducer fitting is to be screwed into Tank, Manway, Riser pipe, Reducer fitting(s).

Product in Tank


- Waste oil and Water mix,
- Other mix (please specify): _____.

Customer Approval

Print name: _____

Signature: _____

Date: _____
 (mm/dd/yyyy)

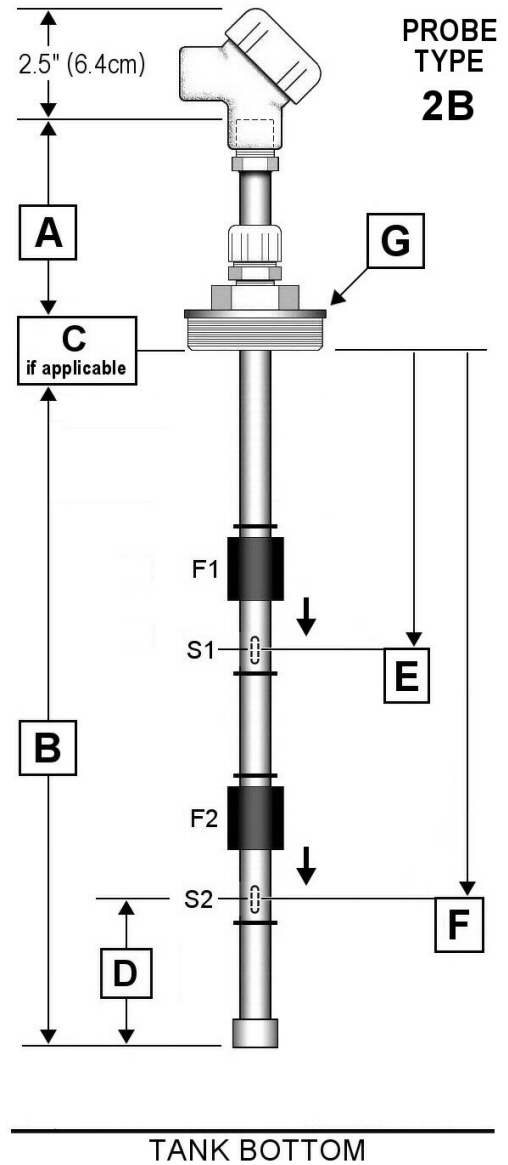

For office use only
ATI-5020-OWS Probe Serial #: _____
Monitor (optional) Model #: _____ Serial #: _____