

ATI-5029 Probe Configuration



A.T.Monitors Order ID #: _____

Customer: _____

PO #: _____, Quantity: _____

PROBE SIZES	STANDARD				NON-STANDARD				
	4'	6'	8'	10'	2'	3'	5'	7'	9'
TUBE LENGTH	55"	79"	103"	127"	31"	43"	67"	91"	115"
IN-TANK LENGTH	47"	71"	95"	119"	23"	35"	59"	83"	107"

Dimensions (in inches, except where noted)

Level measurement increments = 1 inch, 2 cm.

NOTE: Dimensions A+B or A+B+C must equal tube length. If these total more than 127", an extension tube will be added onto the probe top to retain explosion-proof certification.

- [A]- Out-of-tank Length = _____ (minimum 8")
 - [B]- In-tank Length = _____ (refer to table above)
 - [C]- (if applicable) Height of riser pipe above tank = _____
 - [D]- Probe tip to tank bottom = 1"
 - [E]- NPT reducer fitting = 2" (standard), 1-1/2" or Other (please specify) _____.
- The reducer fitting will be screwed into Tank, Riser pipe.

[S]- Maximum level (Span) = _____ (usually 95% of B+D)

For High alarm and Low alarm levels, refer to the ATI-DM335 display module configuration sheet.

Product in Tank


- Diesel, Gasoline, Waste oil, Water,
- Other (please specify) _____.

Customer Approval

Print name: _____

Signature: _____

Date: _____ (mm/dd/yyyy)

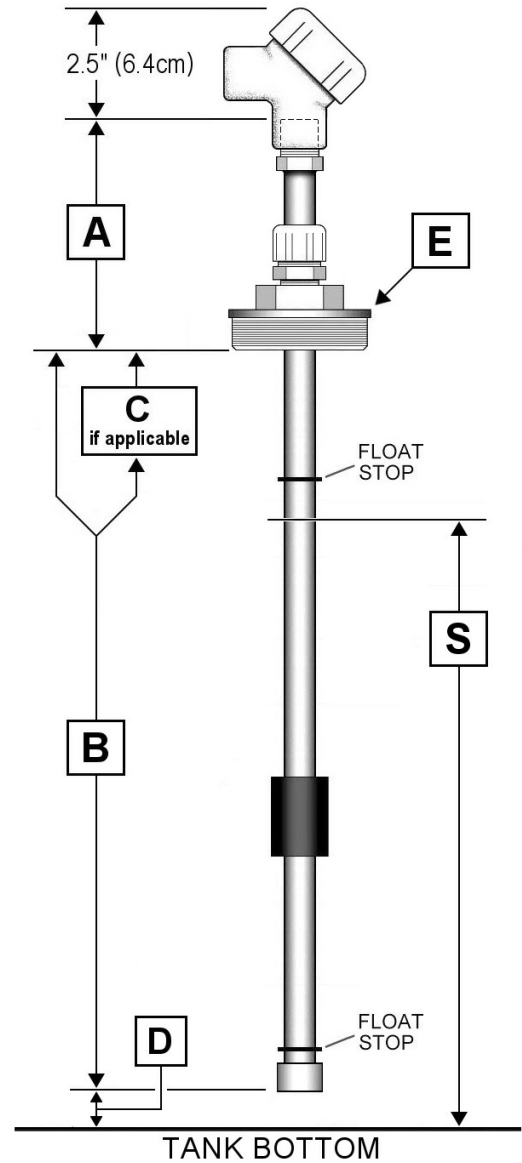

For office use only

ATI-5029 Probe
Serial #: _____

ATI-DM335 Display Module (optional)
Serial #: _____