

# ATI-5029 Probe Configuration



A.T.Monitors Order ID #: \_\_\_\_\_  
 Customer: \_\_\_\_\_  
 Customer PO #: \_\_\_\_\_

Probe dimensions are in  inches,  cm.  
 Level measurement increments =  1 inch,  2 cm.

## Tank

Manufacturer: \_\_\_\_\_, Model #: \_\_\_\_\_

## Dimensions

- [A]- Out-of-tank Length = \_\_\_\_\_ (minimum 8" / 20.3cm)
- [B]- In-tank Length = \_\_\_\_\_
- [C]- Height of manway, riser pipe, reducer fitting(s) or other non-reading portion of [B] = \_\_\_\_\_ (if applicable).
- Total shaft length = **A + B** or **A + B + C**
- [D]- Probe tip to tank bottom = \_\_\_\_\_ (usually 1" / 2.5cm)
- [E]- High Alarm level setpoint = \_\_\_\_\_ (if applicable)
- [F]- Low Alarm level setpoint = \_\_\_\_\_ (if applicable)
- [G]- NPT reducer fitting =  2" (standard),  1-1/2" or  other (please specify) \_\_\_\_\_.

The probe's NPT reducer fitting is to be screwed into  
 Tank,  Manway,  Riser pipe,  Reducer fitting(s).

## Product in Tank


- Diesel,  Gasoline,  Waste oil,  Water,
- Other (please specify): \_\_\_\_\_.

## Customer Approval

Print name: \_\_\_\_\_

Signature: \_\_\_\_\_

Date: \_\_\_\_\_  
 (mm/dd/yyyy)

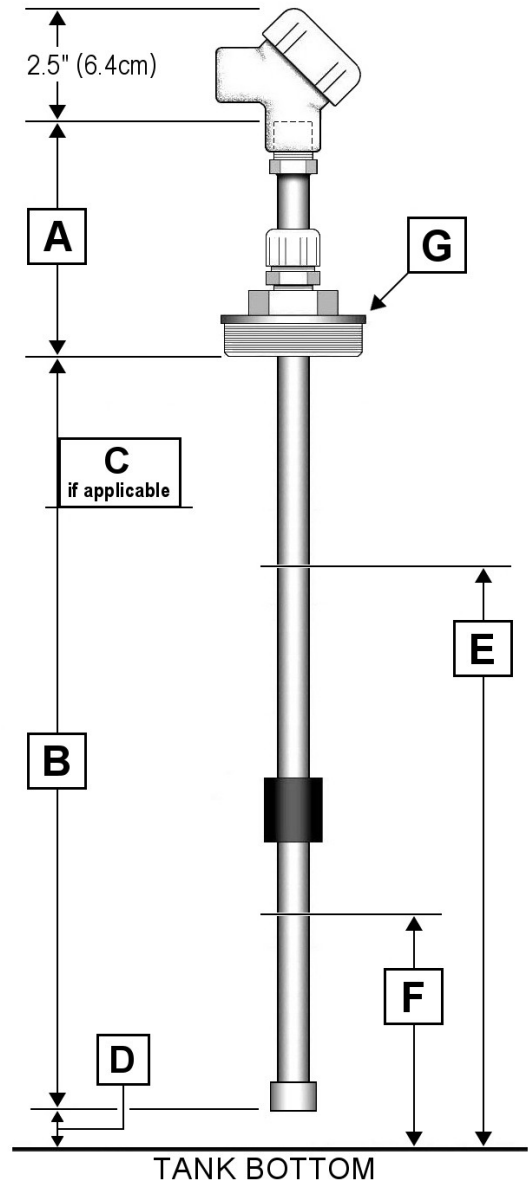

For office use only
<b>ATI-5029 Probe</b> Serial #: _____
<b>ATI-DM335 Module (optional)</b> Serial #: _____